

GUARDIAN-HO-WH-LX

ITEM NO. GUARDIAN - 44653

The Guardian High Output LED Emergency Downlight delivers an energy-efficient and high-performance 5.2W LED solution with an impressive high lumen output of up to 650LM, ideal for emergency lighting applications. Designed for open-area use, it features an integrated optic engineered for optimal light dispersion, ensuring safety and visibility in critical scenarios.

Perfect for plasterboard ceilings, this compact fixture includes a battery pack specifically designed to fit through the fixture's aperture for easy installation. The open-area optic is standard, with a corridor optic accessory included for added versatility.


Note: Please ensure that the appropriate optic is used during installation to meet your project requirements.

Features:


- LED emergency lighting supply unit
- Open area lens (default) and Corridor area lens (included)
- LED module with a forward voltage of 30Vdc
- SELV for output voltage
- Constant power output
- Integral LiFePO4 battery pack
- 850°C Glow-wiring Test

Functions:

- Manual test function
- Non-maintained operation
- Electronic charge system
- Deep discharge protection
- Short-circuit-proof battery connection
- Open-circuit-proof
- Polarity reversal protection for battery

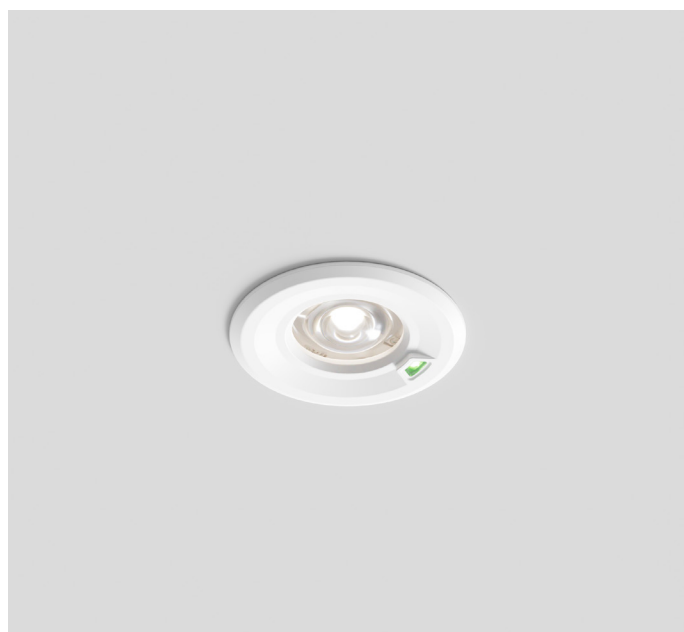

Dimension

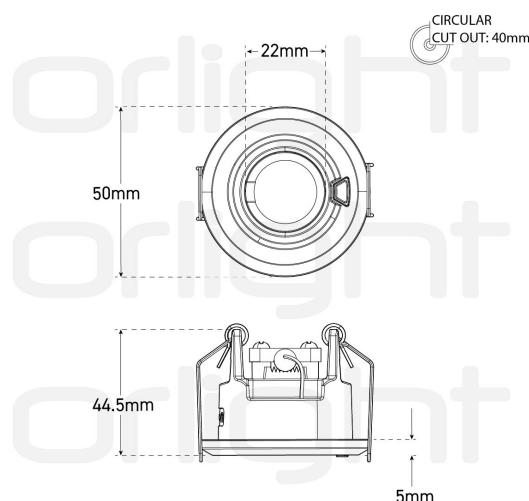

Technical Specification

Item Category	AMENITY	Product Family	GUARDIAN
Product Variant	GUARDIAN	Wattage	5.2W
CCT	6000K	Lumen Output	650LM
Efficacy (Lm/W)	125LM/W	Chipset	SMD 5050 LED
CRI	CRI > 80	Binning	2 STEP MACADAMS
Milliamp / Current	12MA-27MA	Voltage	220-240V
Control	SWITCHED-EM	Emergency	3HRS
Beam Angle	150°	Compatible Light Source	SOLID STATE LED
Lamp Change	SOLID STATE LED	Operating Ambient Temperature	5° C - 45° C
Construction	ALUMINIUM & PC	Finish	WHITE
RAL	RAL 9016	IP Rating	IP20
IK Rating	IK07	Installation	CEILING RECESSED
Diameter	50 MM	Cutout	40 MM
Height	44.5 MM	Weight	0.6KG

GUARDIAN-HO-WH-LX

ITEM NO. GUARDIAN - 44653

Technical Specification

In-rush current	3.5A
In-rush current duration	4ms
Mains surge capability (between L – N)	1KV
Maximum withstand voltage	2KV+4U
Withstand time	60s

Item	Mains input current, min	Mains input current, max	Input power in mains operation, min	Input power in mains operation, max
Guardian High Output	12mA	27mA	0.8W	3.8W

Item	Fixture Luminous Flux	Mode	LED module forward current range Min-Typ-Max	LED module forward power range Min-Typ-Max	LED module forward voltage range Min-Max
Guardian High Output	≥650lm	Open Area	170-176-182mA	4.8-5.1-5.46W	28-30Vdc
		Corridor			


Note:

1. All specifications are typical at 25°C unless otherwise stated.
2. All specifications are typical on the 230VAC unless otherwise stated.

Polar Curve


OPEN AREA VERSION

150°

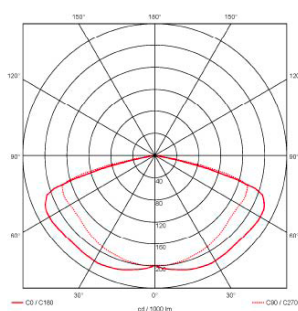

CORRIDOR VERSION

150° x 55°

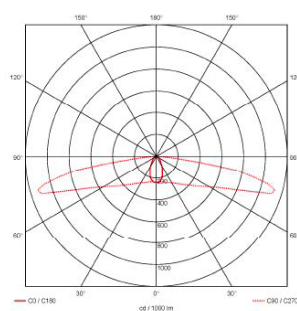

GUARDIAN-HO-WH-LX


ITEM NO. GUARDIAN - 44653

Additional Information

CORRIDOR VERSION



CORRIDOR VERSION

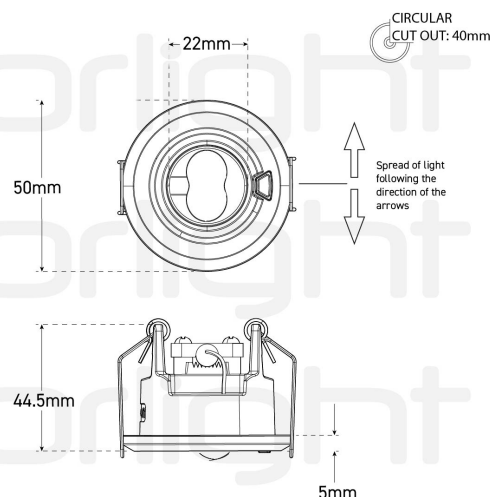


Indicator LED System status is locally by a bi-color indicator LED.

LED Indication	Status	Description	NOTICE Fault status: If an error is detected, the indicator LED switches to RED. If the error has been corrected please reconnect the battery after the mains power off, the indicator LED immediately switches back to GREEN when mains power on. Battery failed duration test: After an exchange of the battery and holding down the button (>10S) reset the timer, the indicator LED switches to GREEN.
Permanent Green	Standby, System OK	Mains Operation, battery is charged	
Fast flashing Green (0.25s on 0.25s off)	Function test underway	Function test underway	
Slow flashing Green (1s on 1s off)	Duration test underway	Duration test underway	
Permanent Red	Lamp failure	Open Circuit or Short circuit or LED failure	
Fast flashing Red (0.25s on 0.25s off)	Battery capacity failure	Battery failed duration test	
Slow flashing Red (1s on 1s off)	Battery fault	Incorrect battery voltage or Short circuit or Open Circuit	
Green and Red off	Battery Operation	Emergency mode: Mains disconnected or Mains failure	
Slow flashing Red (1s on 3s off)	Battery temperature error	When power on and battery temperature is above 55 (+2) °C or below 0 (+2) °C	

GUARDIAN-HO-WH-LX


ITEM NO. GUARDIAN - 44653

Wiring Diagram

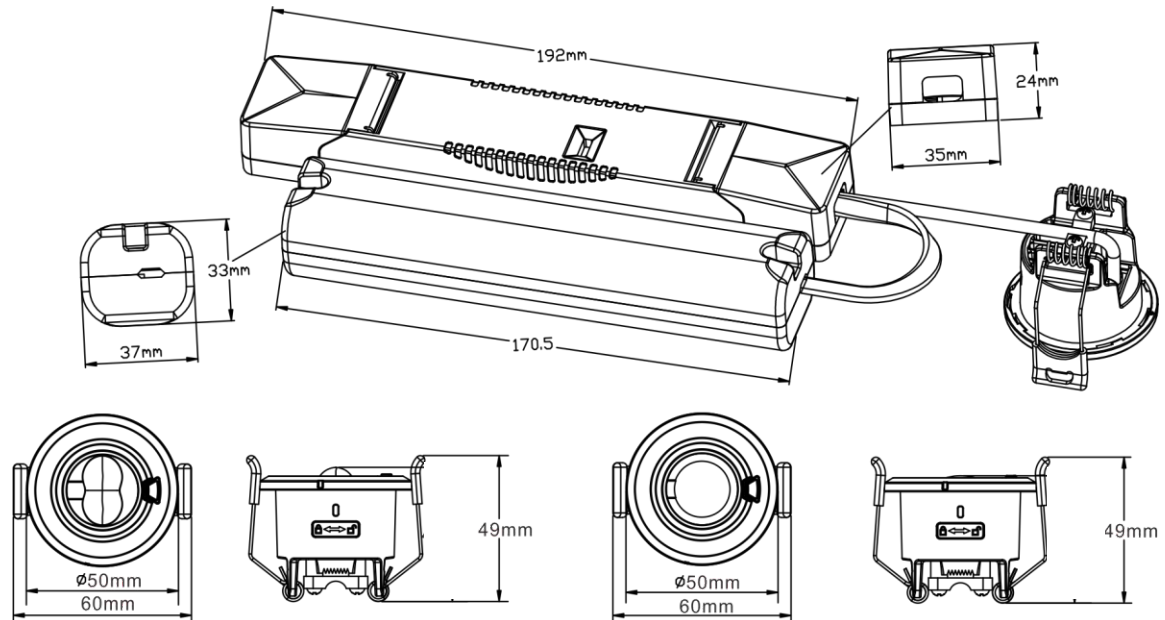

Note:

1. Connect the L and N cables to corresponding connectors to finish AC wiring.
2. The battery should be changed when the battery be failed on charging's ability.
3. Building insulation may abut the sides of the luminaire.

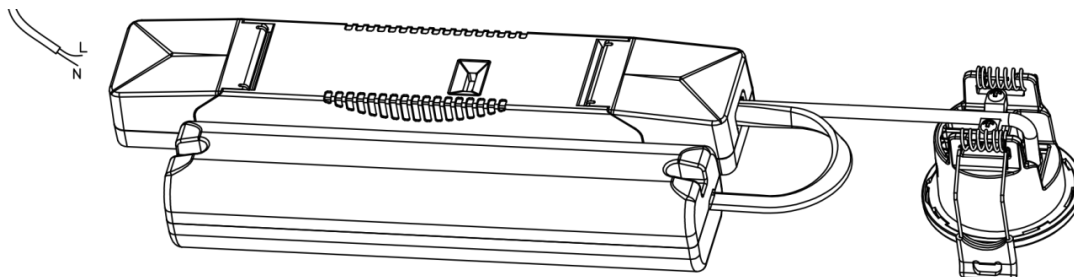

Battery Data

Emergency power	5W
Batteries	26650/6.4V/3000mAh LiFePO4
Emergency Duration	3h
Battery discharge current Min-Typ-Max	800-900-1000mA
Battery output power Min-Typ-Max	6-6.5-7W
Battery fully charged time	16h
Charge Current	200mA±10%
Battery discharge voltage Min-Typ-Max	5.4-6.4-7.3V

Note:

Automatically charge when the voltage of a single battery drops below 3.4V. When the voltage of a single battery exceeds 3.6V, the charger turns off (0mA).

If the battery temperature is above 55 (± 2 °C) or below 0 (+2 °C), the battery will stop charging.

The emergency lighting LED driver will recharge the battery normally after running the test of 61347-2-7 CL22.3 (abnormal operating conditions).

GUARDIAN-HO-WH-LX

ITEM NO. GUARDIAN - 44653

Battery Data

When the voltage of a single battery is below min 2.6 V, the battery will not enter an emergency state.
The minimum charging environment temperature of the battery is 5°C , to ensure that the battery can be charged.

Battery selection

Capacity	3.0Ah
International designation	IFpR 26/65
Battery voltage/cell	3.2V
Cell type	26650
Case temperature range to ensure	
4 years design life	+5°C to +55°C
5 years design life	+5°C to +45°C
6 years design life	+5°C to +35°C
Max. short term battery case temperature (shorter than 1 month over the battery lifetime)	70°C
Max. number discharge cycles	50 cycles total
Max. storage time	6 months

Notice: Storage condition

- Batteries should be stored within the specified temperature range in low humidity conditions.
- Optimal storage conditions are
- Temperature: -20°C to +40°C
 - Humidity: 45% - 85%
 - Avoid atmosphere with corrosive gas
 - It is recommended to disconnect the battery before storage or delivery
 - Battery should be charged every three months in order to keep it's initial performance.

Standard

This product meets the following standards:

- | | | | |
|--------------------|-------------------|----------------|------------|
| • EN IEC60598-1 | • EN IEC61347-1 | • EN 61000-3-3 | • EN 55015 |
| • EN IEC60598-2-1 | • EN IEC61347-2-7 | • EN 61547 | • ROHS 2.0 |
| • EN IEC60598-2-22 | • EN 61000-3-2 | • EN 62034 | |

Service Life

Average life-time 50,000 hours under rated conditions with a failure rate of less than 10% for the emergency converter as rated power. Average failure rate of 0.2% per 1000 operating hours.

Important

The electric source for safety service is not a user serviceable item and shall only be replaced by the manufacturer service agent or a similar qualified person.

The light source contained in this luminaire shall only be replaced by the manufacturer or his service agent or a similar qualified person.

The company accept no responsibility for incorrect installation, incorrect operation or improper maintenance.

After installation of the fitting, the battery must be charged for 24 hours for duration test.

The drawing in the fitting may vary to the actual product, connect as per label on fitting.

When fitting a flush fitting, refer to installation instruction, including any ceiling manufacturer's instructions.

The recharging device will recharge the battery ESSS normally after removal the short circuit link and reconnecting the ESSS.

Double or reinforce insulation between supply and battery/ESS circuits and based on a working voltage of 250V;

GUARDIAN-HO-WH-LX

ITEM NO. GUARDIAN - 44653

Disclaimer

This product must be installed by a skilled or instructed person in accordance with the current edition of the IET Wiring Regulations BS 7671 "Requirements for Electrical Installations" and the Buildings Regulations, as may be applicable subject to the location and country of the installation.

Should this product be modified, misused or not installed as per the instructions given, the product warranty shall be rendered void.

All information contained within these installation instructions manual is provided in good faith. Orlight shall not be held responsible for any losses incurred as a result of the Customer's failure to follow the instructions manual thoroughly and in its entirety or failing to inspect the product for missing parts and/or any defects prior to installation.

For full Terms and Conditions, please visit our website at: <https://www.orlight.com/en/terms-and-conditions.html>

Wiring:

Disconnect the mains supply before installation. Ensure that the unit is installed and maintained by a certified professional and that installation conforms to any local building control standard applicable.

Accessories:

Please ensure that any accessory used in conjunction with these products is approved by Orlight. Failure to do so will void any product guarantee. Orlight will not be held responsible for any loss incurred be it direct or consequential.

Note: Light fittings in general can become hot whilst in operation. It is advisable that they do not come into contact with any flammable materials such as fabrics, furniture, soft furnishings or touched during/after operation.